

F1 Issues

As of 24 December, 2014
Nuclear Regulation Authority (NRA), Japan


Current Information on Radioactivity in Seawater

Measurements of seawater obtained at the sampling points T-1 and T-2-1 from 14 to 21 December are shown in the following table. All radionuclides (i.e., Cs-134, Cs-137, total Beta and H-3) remained low and stable in the period.

The following URL of the NRA website leads to details of monitoring results:
http://radioactivity.nsr.go.jp/en/contents/10000/9264/24/Sea_Area_Monitoring_20141224.pdf


Sampling Date in 2014	Cs-134 (Bq/L)		Cs-137 (Bq/L)		*Total Beta (Bq/L)		H-3 (Bq/L)	
	T-1	T-2-1	T-1	T-2-1	T-1	T-2-1	T-1	T-2-1
14 Dec.	ND	ND	ND	ND	–	9.7	–	–
15 Dec.	ND	ND	ND	ND	10	13	3.7	ND
16 Dec.	ND	ND	ND	ND	–	13	–	–
17 Dec.	ND	ND	ND	ND	–	15	–	–
18 Dec.	No samples due to bad weather							
19 Dec.	1.0	ND	4.4	ND	–	10	–	–
20 Dec.	ND	ND	ND	ND	–	15	–	–
21 Dec.	ND	ND	ND	ND	–	14	–	–

ND: Under the limit of detection
(less than 1Bq/L for Cs-134/Cs-137; 5Bq/L for Total Beta; and 3Bq/L for H-3)
*Total Beta includes K-40 occurring naturally in seawater.

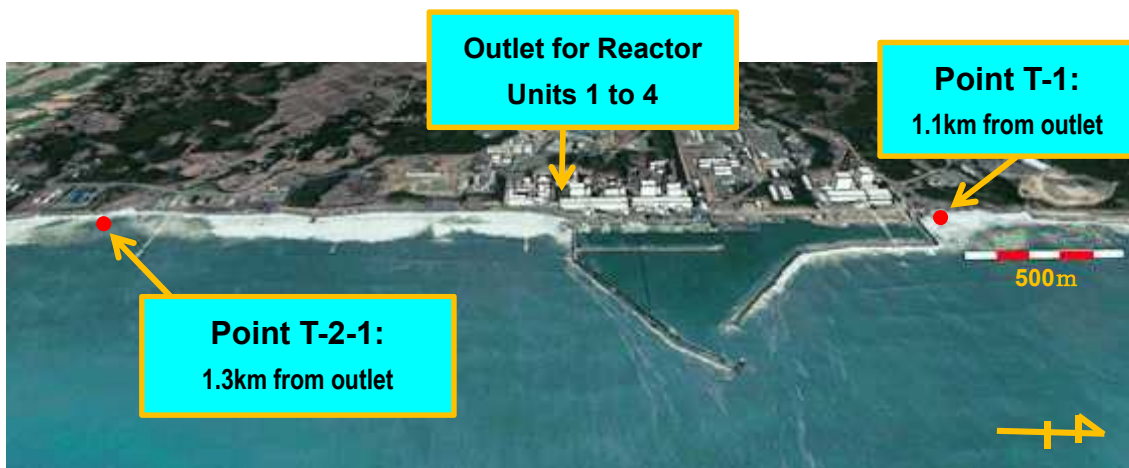

The concentrations of Cs-134 and Cs-137 monitored at the sampling points T-1 and T-2-1 from 10 December 2013 to 21 December 2014 are shown in the following figure. The values under the limit of detection are not plotted on the figure. Seawater samples are taken every day except for days of bad weather.

Sampling points: T-1 and T-2-1

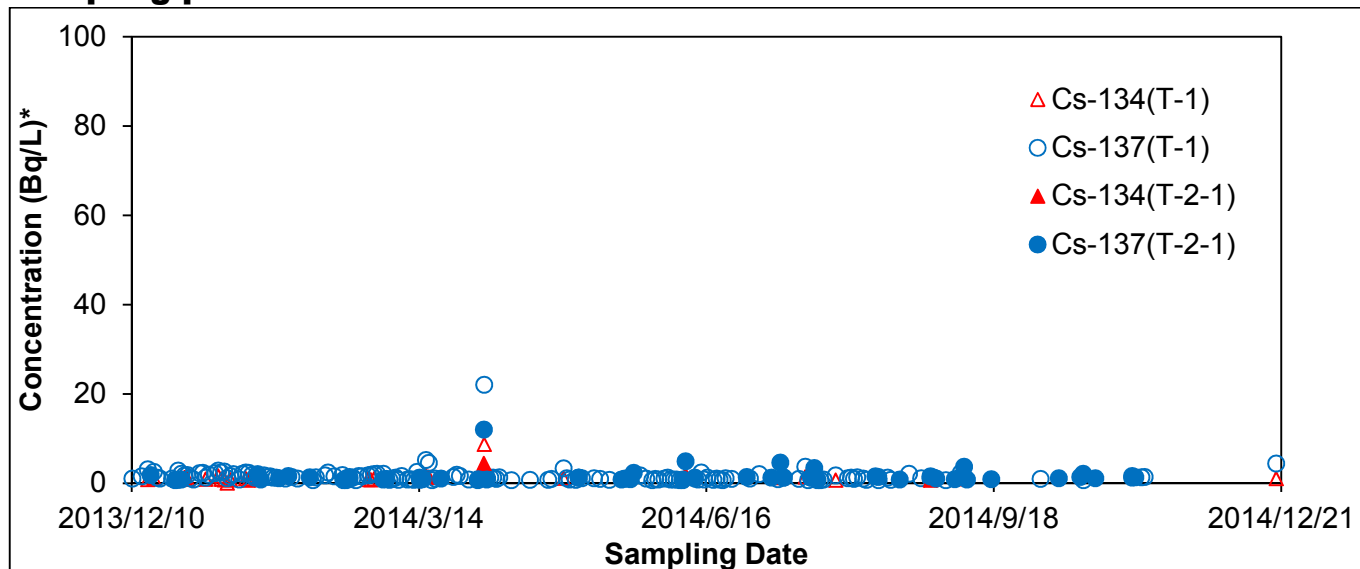

*The scale is set taking into account the limit values of concentrations (e.g., 60 Bq/L for Cs-134, 90 Bq/L for Cs-137, 60,000 Bq/L for H-3) in water for release of radioactive materials from a nuclear facility to the environment, which have been based on Japan's Act on the Regulation of Nuclear Source Material, Nuclear Fuel Material and Reactors as well as the standpoints of International Commission on Radiological Protection (ICRP).